


Competing Transmission Proposals in the AC Transmission Proceeding as of October 3, 2013 Cases 12-T-0502 & 13-E-0488

NOT ALL PROJECTS WILL BE PURSUED

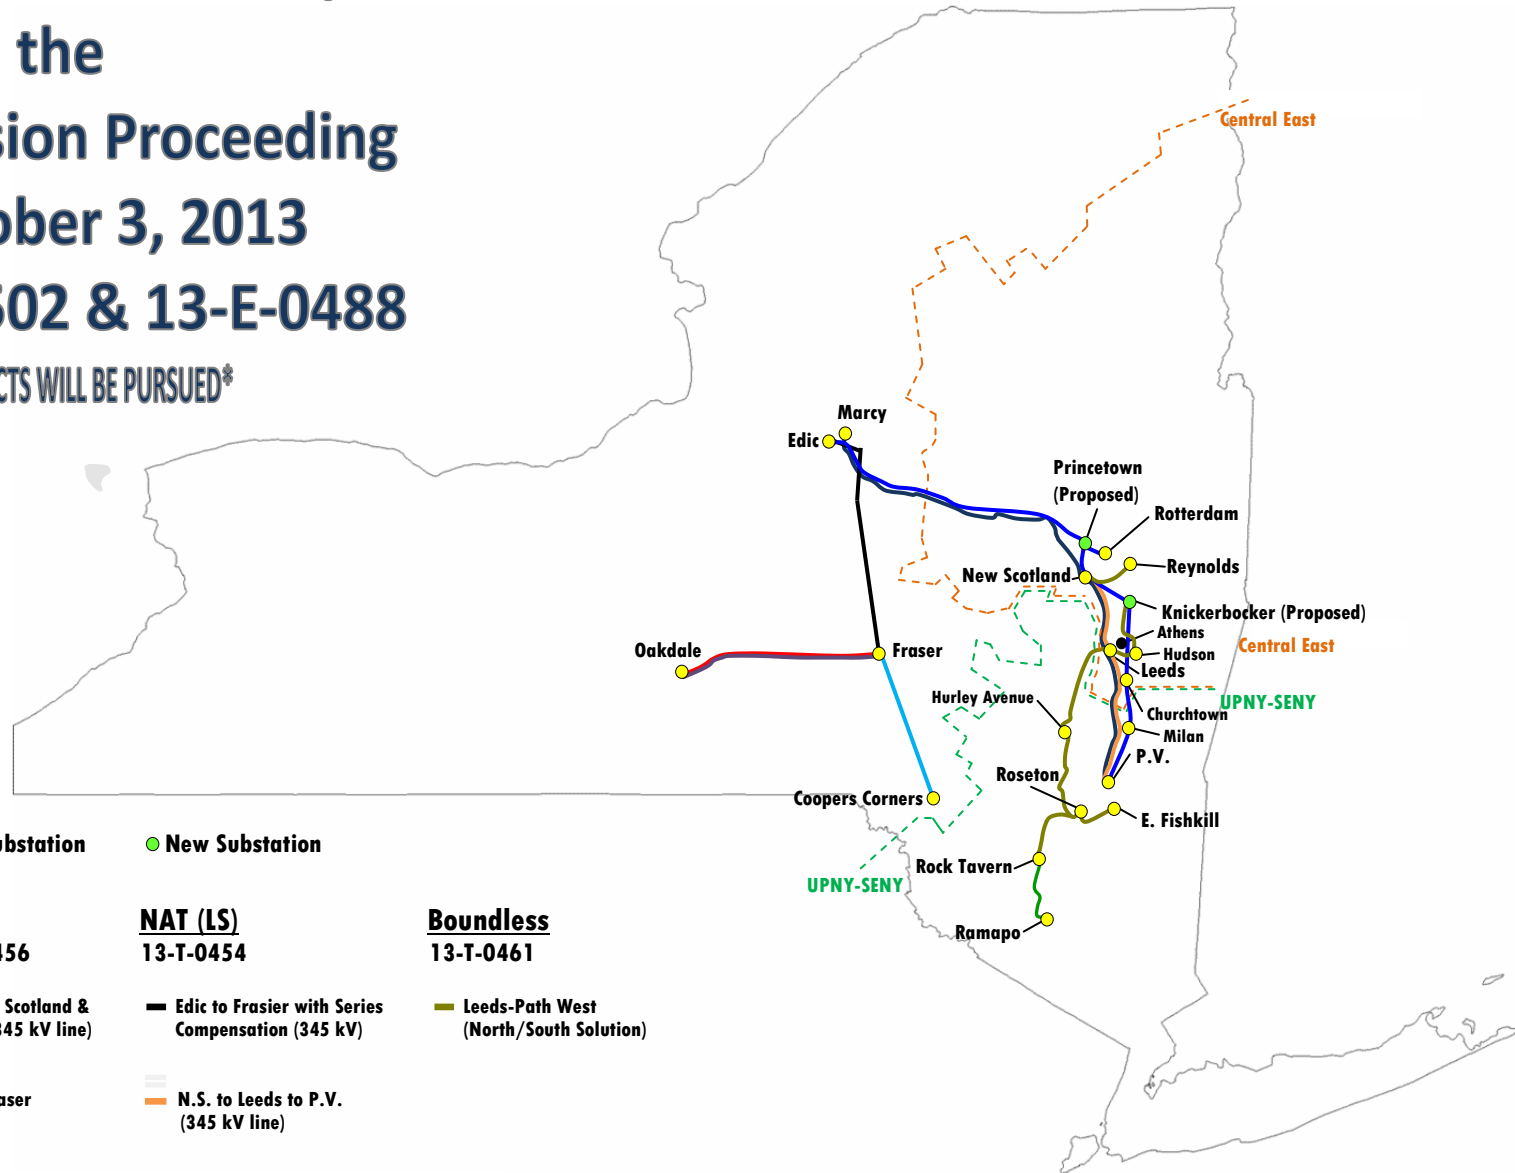

Legend

● Existing Substation ● New Substation

NY Transco 13-M-0457

- Marcy South Series Comp & Fraser to Coopers Corners Reconductoring
- 2nd Ramapo to Rock Tav (345 kV line)
- Edic to Pleasant Valley (345 kV line)
- 2nd Oakdale to Fraser (345 kV line)

NEXtera 13-T-0455/-0456

- Marcy to New Scotland & N.S. to P.V. (345 kV line)
- Oakdale to Fraser (345 kV line)

NAT (LS) 13-T-0454

- Edic to Frasier with Series Compensation (345 kV)
- N.S. to Leeds to P.V. (345 kV line)

Boundless 13-T-0461

- Leeds-Path West (North/South Solution)